

MEDIUM VOLTAGE AMP-TRAP FUSE


A055B2D0R0-(450-600)E

BOLT-IN 5.5KV

TOTAL CLEARING TIME CURRENT CURVE

FERRAZ SHAWMUT
NEWBURYPORT, MA 01950

720455

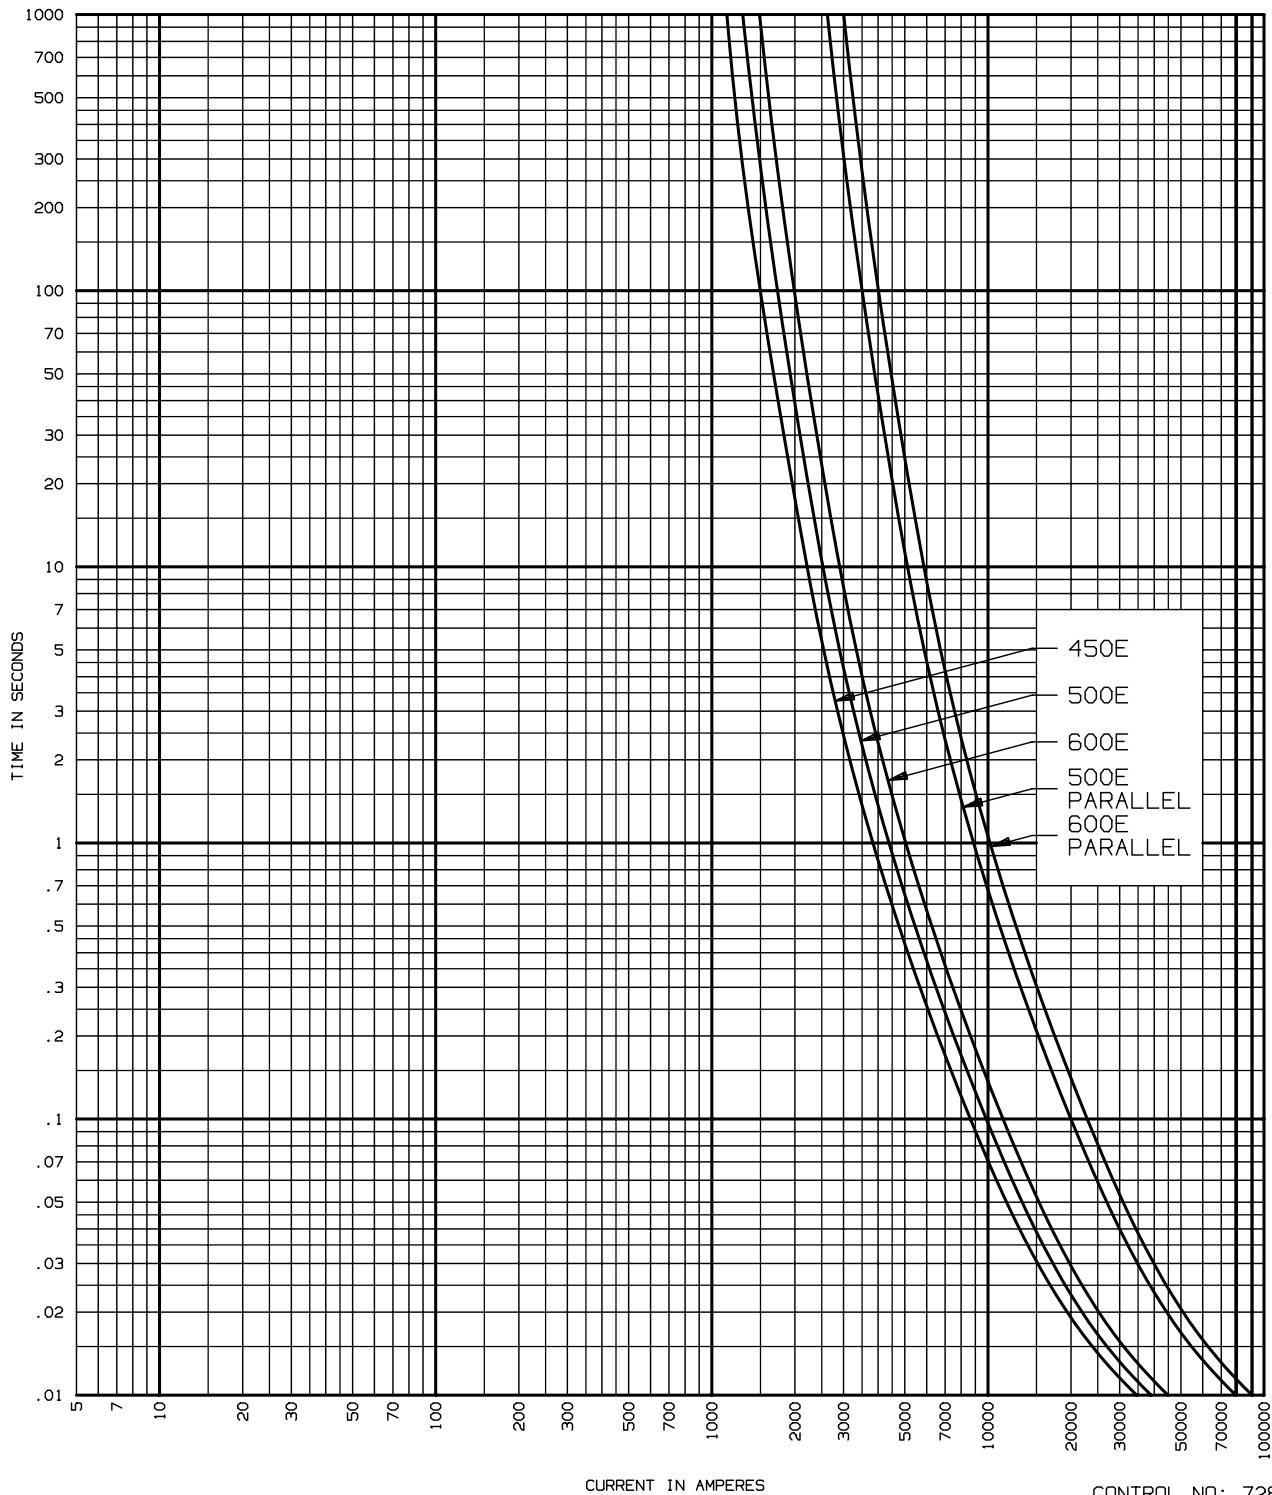

CONTROL NO: 728
FOLDER NO. 5B
REV. A
2/10/05