

MEDIUM VOLTAGE AMP-TRAP FUSE


A155B2D0R0-200E

BOLT-IN 15.5KV

TOTAL CLEARING TIME CURRENT CURVE

FERRAZ SHAWMUT
NEWBURYPORT, MA 01950

720794

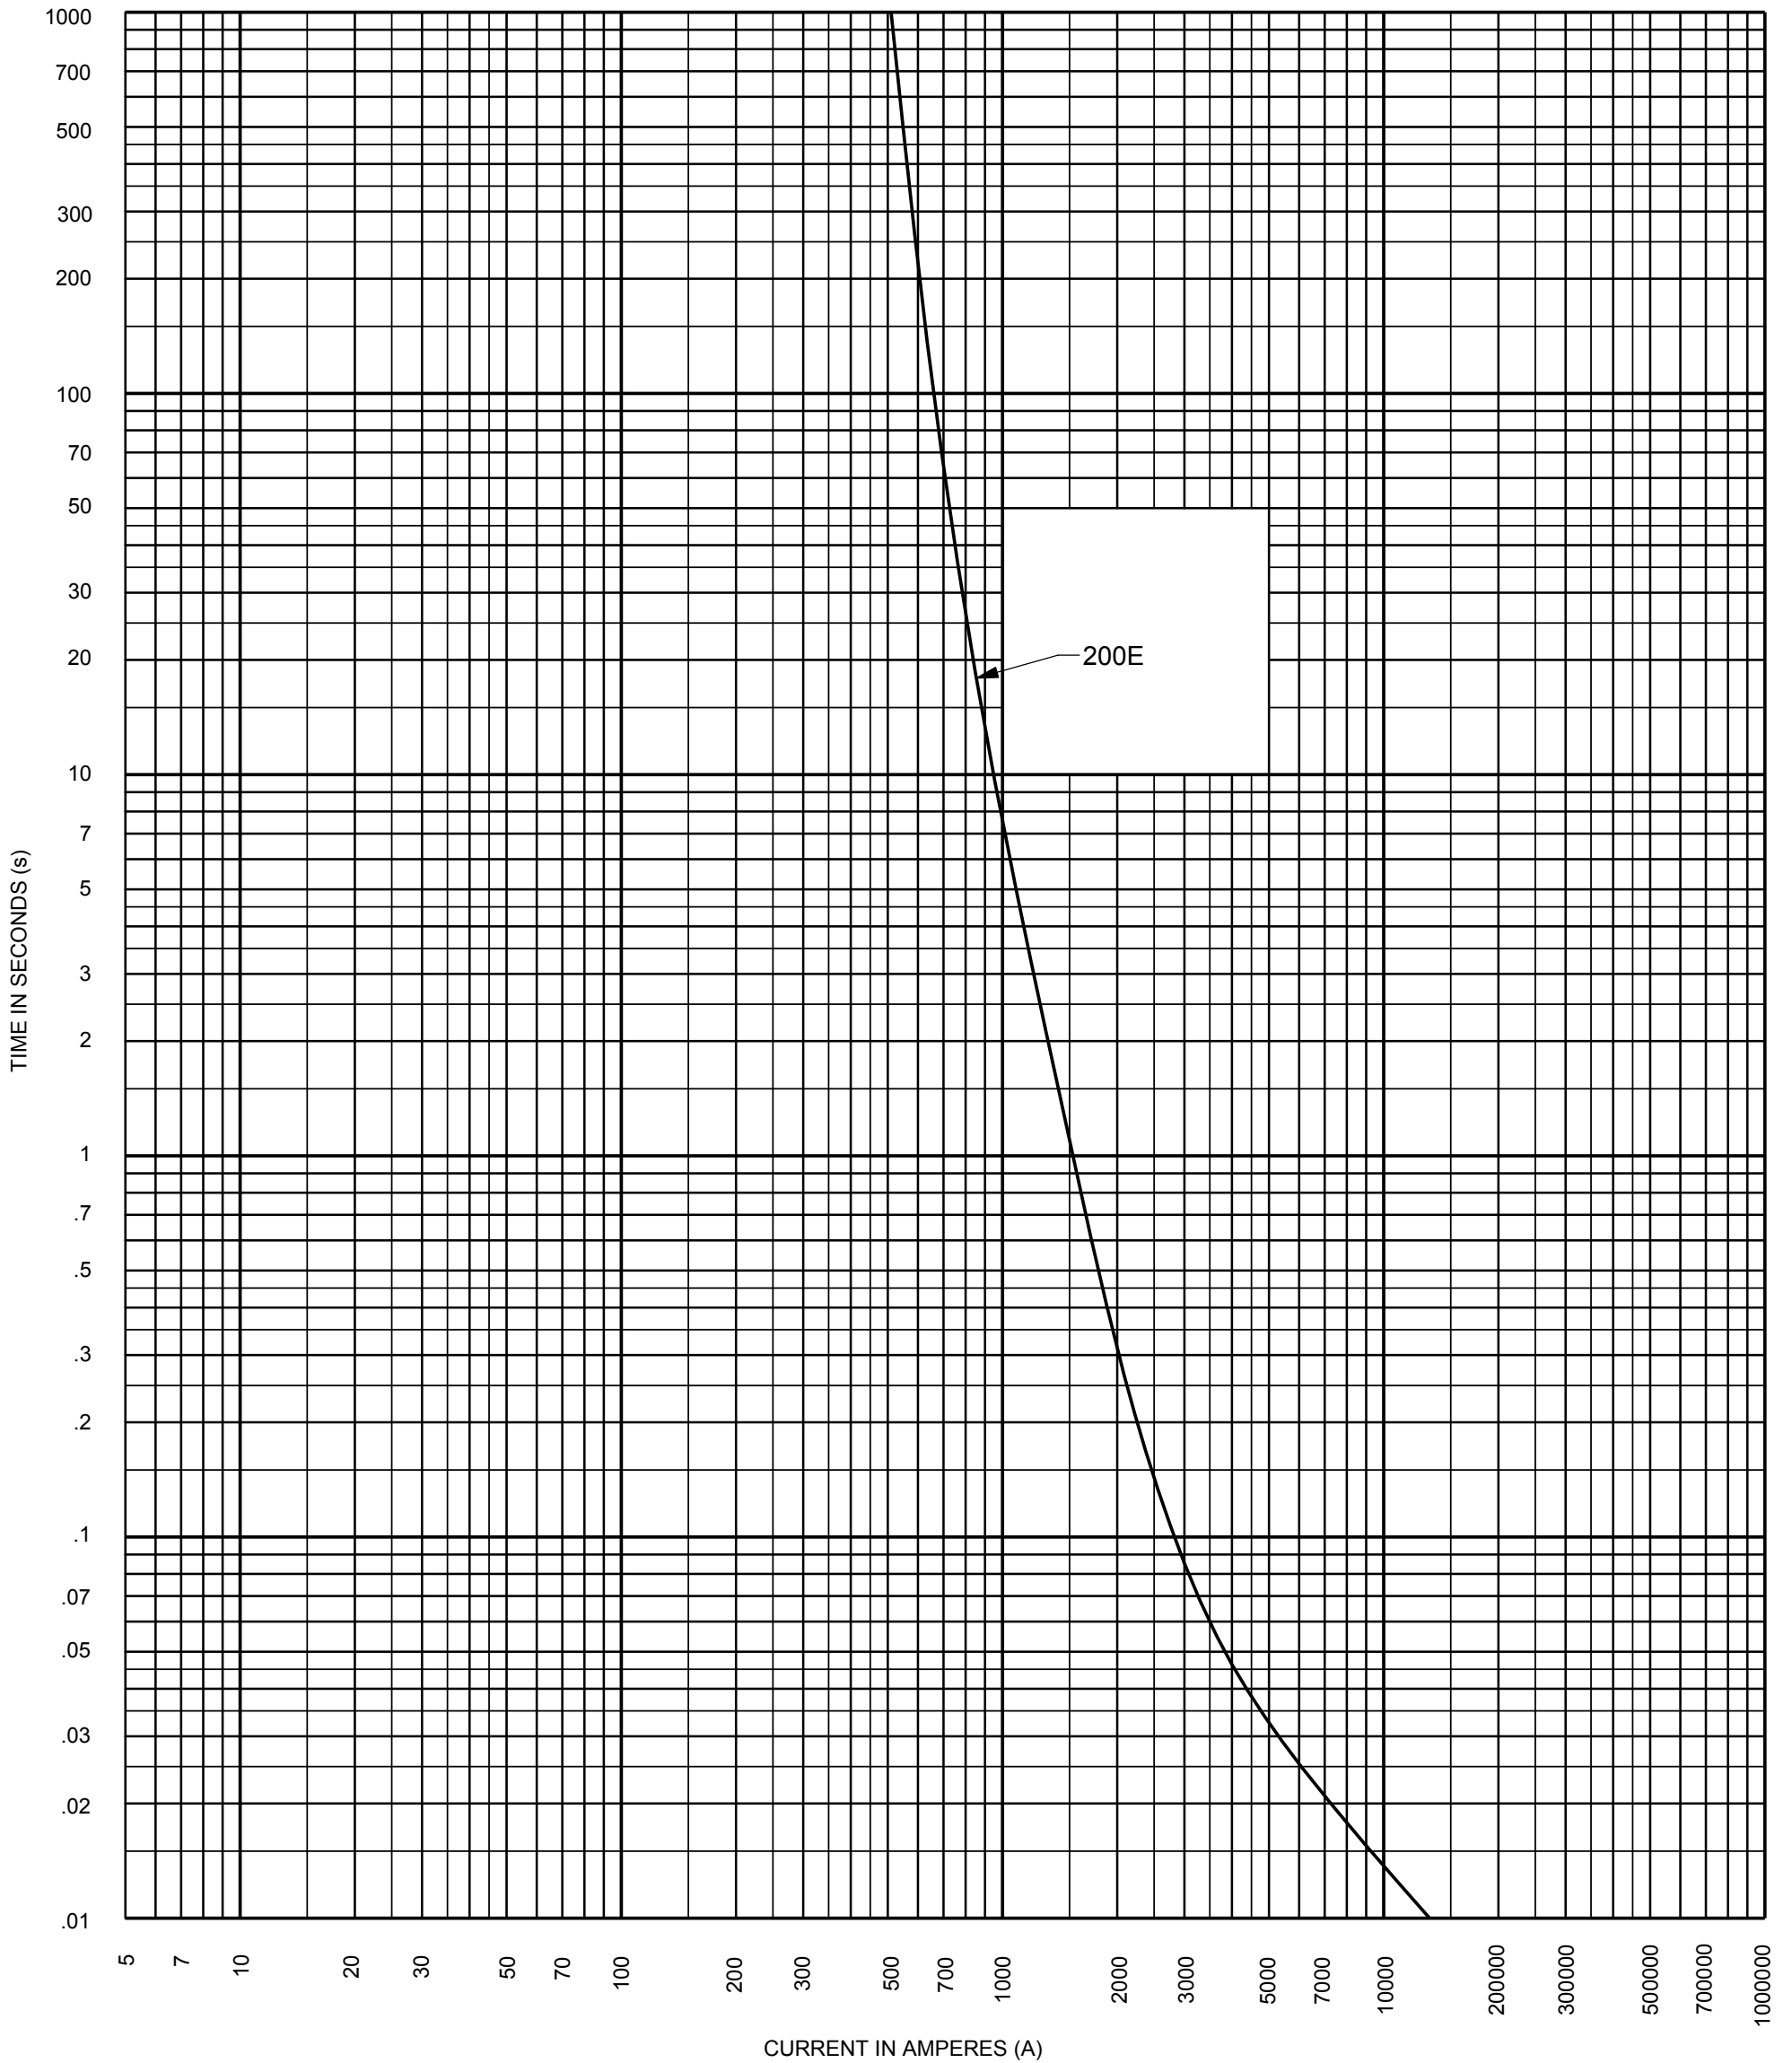

CONTROL NO.: 859
REV.: -
FOLDER NO.: 5C
DATE: 1-3-06