

MEDIUM VOLTAGE CAPACITOR FUSE


CAT. NO. A250C(25-150)-10, -50

25-150A 2.5kV

TOTAL CLEARING TIME CURRENT DATA

FERRAZ SHAWMUT
NEWBURYPORT, MA 01950

720576

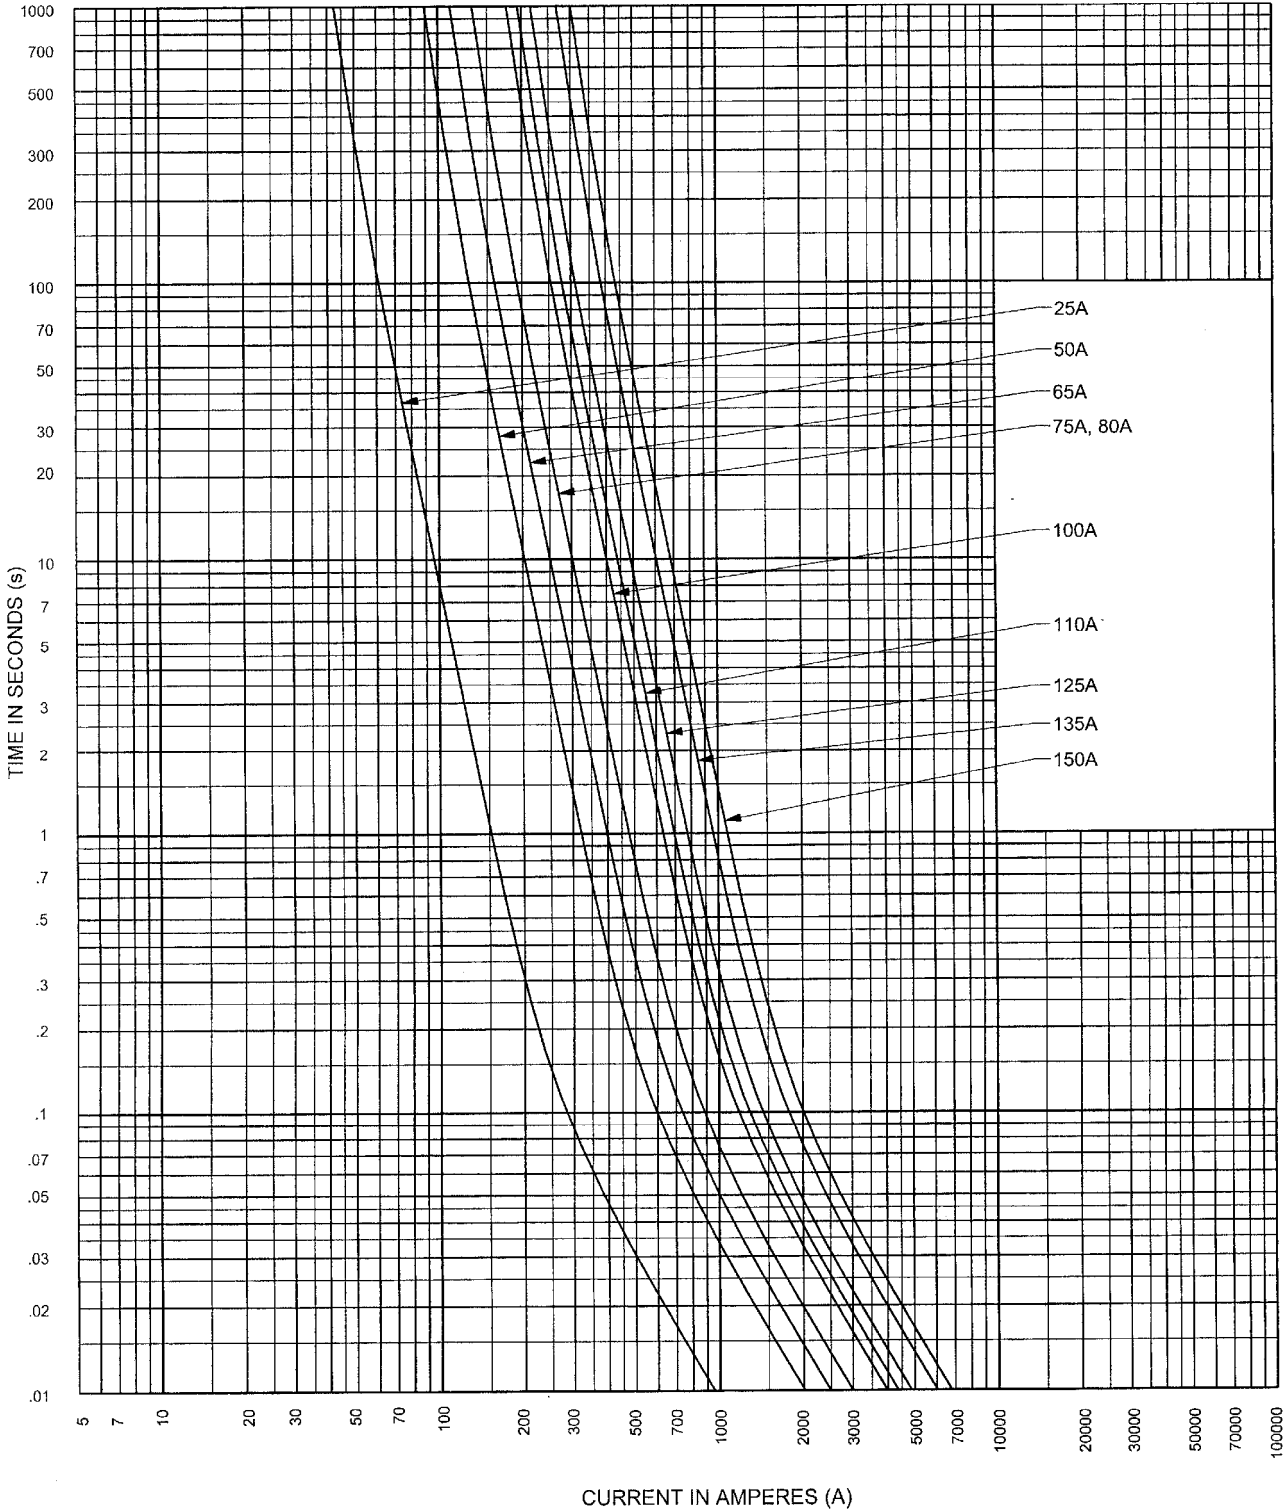

CONTROL NO.: 830
REV.: A
FOLDER NO.: 47
DATE: 9-14-05